




## Fasteners

Asphalt shingles shall be fastened with not less than four nails. Nails shall be not less than 12-gauge with 3/8 inch minimum diameter heads. Nails shall be of sufficient length to penetrate through roofing material and at least 3/4 inch into roof sheathing or through the thickness of the sheathing, whichever is less. Nail head shall be driven so that it tightly bears against the shingle but does not cut the surface of the shingle. Nails must be installed in the location on each shingle per the manufacturer's instructions. **Any crooked nails should be removed and replaced.** (See illustration)

**Note:** Use of other types of fasteners must be approved by the Building Inspection Division.

## Sheathing

Roof sheathing shall be checked prior to re-roofing and repaired or replaced if rotted or unsound. Replacement sheathing shall conform to the requirements of the Building Code and the manufacturer of the product.

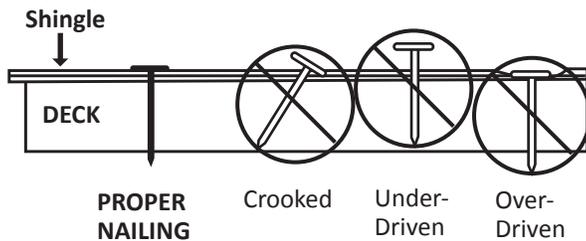

## Roof pitch

Asphalt shingles **shall not** be used on roofs with less than a 2:12 pitch and require special application procedures for pitches less than 4:12. Manufacturer's instructions on package must be followed.

## Underlayment

### A. For roof pitches of 2:12 to less than 4:12

Two layers of 15# felt applied shingle fashion. Starting with a 19 inch strip and a 36 inch wide sheet over it at the eaves, each subsequent sheet shall be lapped 19 inches horizontally.

**Note:** For ice protection materials, the manufacturer's installation instructions must be followed.

### B. For roof pitches of 4:12 and over

One layer of 15# felt lapped 2 inches horizontally and 4 inches vertically. End laps shall be offset by six feet in all applications.

## Valley underlayment

Valley linings shall be installed per the manufacturer's requirements before applying shingles.

## Ice barrier membranes

*Required for all building structures. An exception is provided for **detached**, accessory structures that contain no conditioned floor area.*

### A. For roof pitches of 2:12 to less than 4:12

Same as for underlayment and, additionally, an approved waterproofing underlayment shall be installed to a point no less than 24 inches inside the exterior wall line. When the manufacturer's specifications are more restrictive than the Building Code, the manufacturer's specifications shall be followed

### B. For roof pitches of 4:12 and over


Same as for underlayment and, additionally, a manufactured ice protection membrane or its code-approved equivalent assembly must be installed per manufacturer's instructions including, but not limited to, the following: The membrane shall extend from over the metal or wood drip edge to a point not less than 24 inches measured horizontally inside the exterior wall line. Depending on the depth of the soffit and width of the product, more than one layer could be required. The underlayments **must** extend to the outer edge at all fascia boards.

(continued)

## Asphalt Roofing Shingles Info Sheet (cont.)

### Vertical wall flashing (26-gauge)

1. Apply shingles up the roof until a course must be trimmed to fit at the base of the vertical wall. Plan to adjust the exposure slightly (and evenly) in the previous courses, so that the last shingle is at least 8 inches wide (vertically). This allows a minimum 5 inch exposure of the top course and a 3 inch headlap.

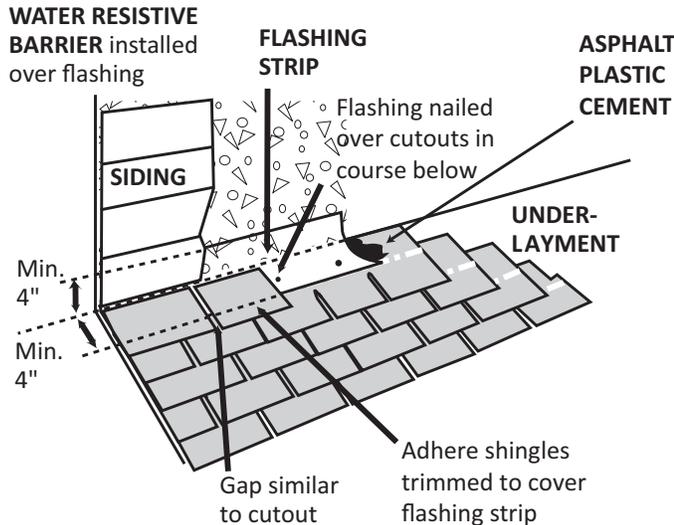

2. The flashing strip should be bent, using a metal brake, to extend at least 4 inches up the vertical wall and at least 4 inches onto the last shingle course; that is, to the top of the cutout.
3. Apply the flashing, 8 inches to 10 inches over the last course of shingles. Embed the flashing in asphalt plastic cement, or another appropriate adhesive, and nail it to the roof every 12 inches. Do not nail the strip to the wall.
4. If side laps are necessary, overlap the pieces at least 6 inches. Do not fasten in this joint area.

**Note:** Drip edge flashing is not a code required flashing.


### Valley flashing

When existing flashing is no longer serviceable, it shall be replaced. Valley flashing shall consist of not less than No. 26-Gauge corrosion-resistant, galvanized sheet metal or other code approved, valley lining material. The metal shall extend at least 12 inches from the center line each way. Sections of flashing shall have an end lap of not less than 4 inches. Alternately, the valley may consist of woven asphalt singles or closed-cut style applied in accordance with the manufacturer's instructions.


### Shingle application around flashing

Top and sides:  
**SHINGLES** overlap flange  
and are set in  
asphalt plastic cement

Bottom:  
**FLANGE** overlaps  
shingles

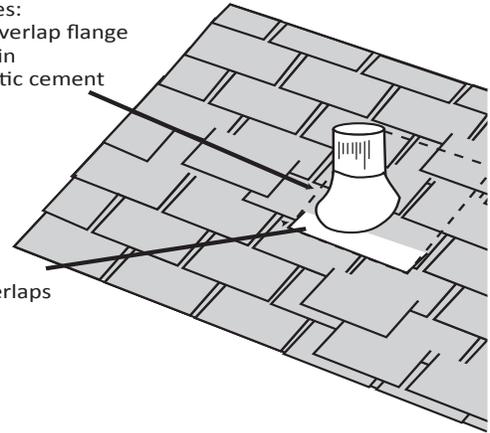

### Sidewall flashing (26-Gauge)

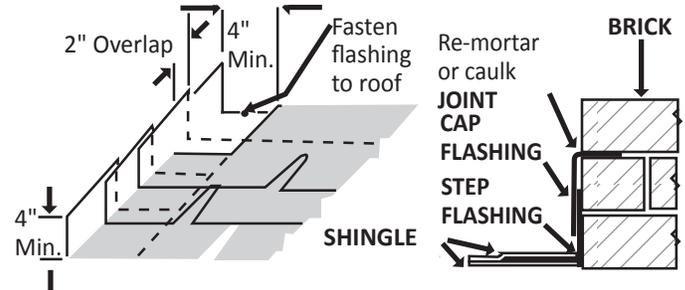


### Other flashing

All other flashing and roof vents shall be checked and if rusted or in bad condition shall be replaced. When replacing flashing of metal, it shall be of not less than No. 26-Gauge corrosion-resistant metal. Roof vents and other flashings must be installed according to manufacturer's instructions. Generally, all require the bottom part of the vent to be placed above the shingles so that about half of the vent is above the lower shingles and half is below the uppermost shingles. Any replacement of flashing at masonry chimneys must be properly cut in and re-tuckpointed or caulked with an approved product.

(continued)

## Asphalt Roofing Shingles Info Sheet (cont.)

### Ice barrier underlayment

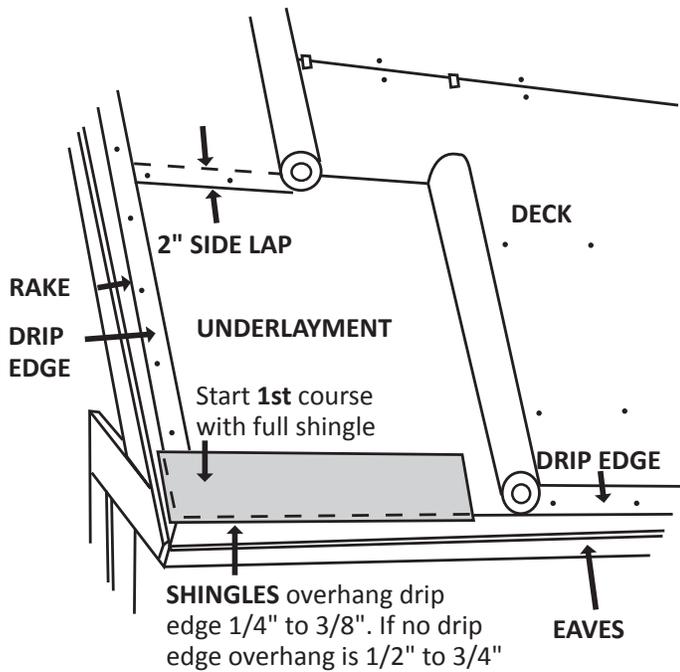


**Installation:** When applying underlayment, keep the product as wrinkle-free as possible. Unroll the underlayment parallel with the eaves. The underlayment should go over eaves' drip edge flashing, but go under the rake's drip edge flashing.


### Kick-out flashing R903.2.1

#### WATER RESISTIVE BARRIER/HOUSEWRAP

Place **over** Step Flashing

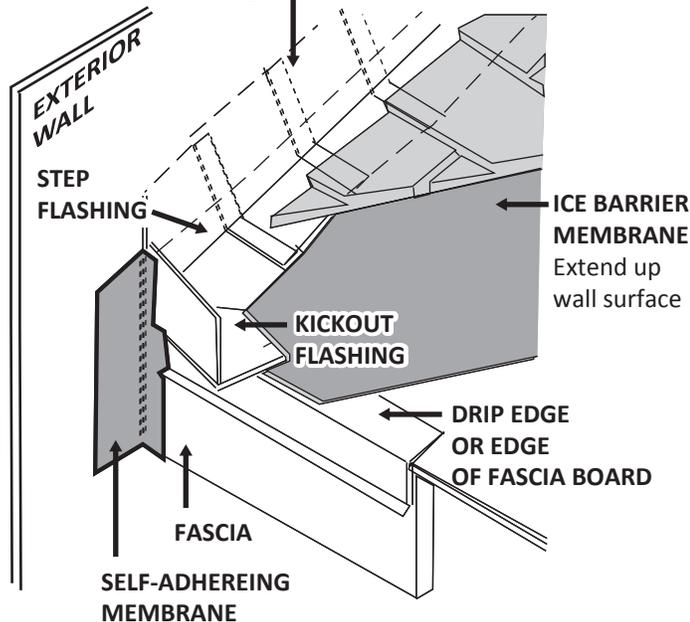

### Where to use ice barrier

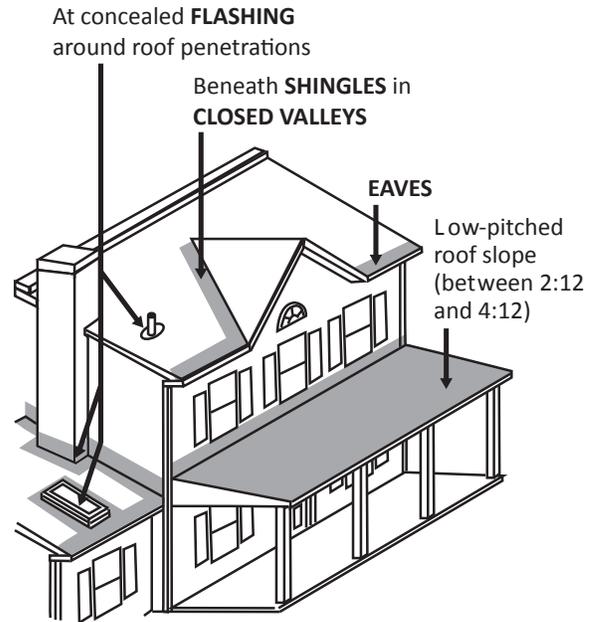

### Roof and soffit vents

If necessary, additional roof and soffit vents must be installed so that for every 300 square feet of attic area there is at least 1 square foot of ventilation. At least 40 percent, but not more than 50 percent of the required ventilating area is provided by ventilators located in the upper portion of the attic or rafter space. Upper ventilators shall be located no more than 3 feet below the ridge or highest point of space, measured vertically, with the balance of the required ventilation proved by eave or soffit vents.

### Exhaust vents

Care should be taken to ensure that kitchen and bathroom exhaust fan pipes are connected to the appropriate dampered exhaust roof vent with no openings into the attic that would allow exhaust air back into the attic space. The exhaust vents shall be installed the same as other attic vents and vent pipe flashings. When re-roofing around furnace flues, take care to not dislodge the joints of the flue pipe within the attic or within interior chases this pipe might pass through. If in doubt, consult a state bonded mechanical contractor.


### Crickets and saddles

**R100.3.20 Crickets and saddles.** A cricket or saddle shall be installed on the ridge side of any chimney or penetration more than 30 inches wide as measured perpendicular to the slope. Cricket or saddle coverings shall be sheet metal or of the same material as the roof covering.

(continued)

## Asphalt Roofing Shingles Info Sheet (cont.)

### Shingle application using 5-inch method

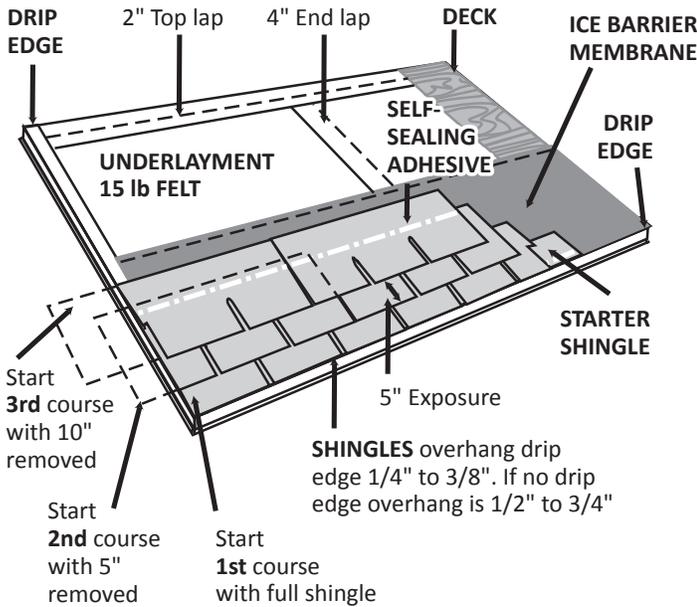

## Skylight: Basic sheet metal components

All dimensions approximate


**BACKER FLASHING** under shingles minimum 3 courses. Where necessary (depending upon anticipated debris and/or snow accumulation), hold shingles up 1 course and nail high.

**INTEGRAL COUNTER FLASHING** with hemmed drip edge

**COUNTER FLASHING** over base and step flashing approx. 2" min.

**APRON FLASHING** with lower edge hemmed under

**RAISED CURB** (2" x 8" suggested as minimum to attain flashing clearance)

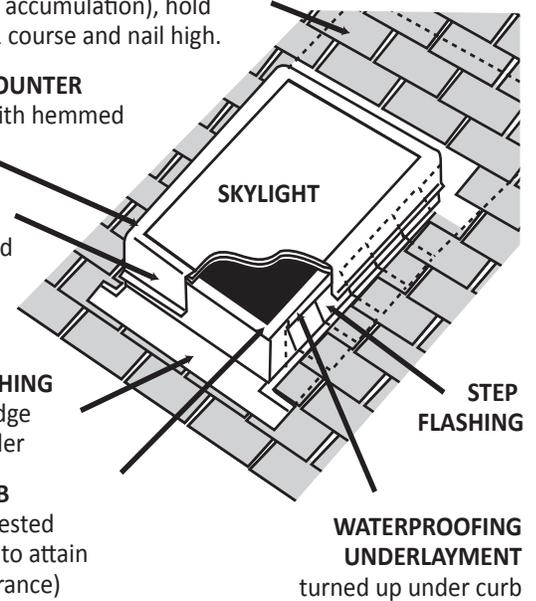

## Valley lining material

**R905.2.8.2 Valleys.** Valley linings shall be installed in accordance with the manufacturer's installation instruction before applying shingles. Valley linings of the following types shall be permitted:

1. For open valleys (valley lining exposed) lined with metal, the valley lining shall be at least 24 inches wide and of any of the corrosion-resistant metals in Table R905.2.8.2.
2. For open valleys, valley lining of two plies of mineral surfaced roll roofing, complying with ASTM D 3909 or ASTM D 6380 Class M, shall be permitted. The bottom layer shall be 18 inches and the top layer a minimum of 36 inches wide.
3. For closed valleys (valley covered with shingles), valley lining of one ply of smooth roll roofing complying with ASTM D 6380 Class S Type III, Class M Type II, or ASTM D 3909 and at least 36 inches wide or valley lining as described in Items 1 and 2 above shall be permitted. Specialty underlayment complying with ASTM D 1970 may be used in lieu of the lining material.

Table R905.2.8.2 - Valley Lining Material

Material	Minimum Thickness	Gage	Weight
Cold-rolled copper	0.0216 Nominal	-----	Astm B 370, 16 oz. per square foot
Lead-coated copper	0.0216 Nominal	-----	Astm B 101, 16 oz. per square foot
High-yield copper	0.0162 Nominal	-----	Astm B 370, 16 oz. per square foot
Lead-coated High-yield copper	0.0162 Nominal	-----	Astm B 101, 16 oz. per square foot
Aluminum	0.024	-----	-----
Stainless steel	-----	28	-----
Galvanized steel	0.0179	26 (Zinc coated G90)	-----
Zinc alloy	0.027	-----	-----
Lead	-----	-----	2.5
Painted terne	-----	-----	20

For Si: 1 inch = 25.4 Mm, 1 pound = 0.454 Kg.